

Even Better Silk Metallic on 39 mm (1,5 inch) acoustical board (density: 96 kg/m³) Type A mounting

SOUND ABSORPTION COEFFICIENT PER ASTM C423-17


Measurement of sound absorption coefficient by the reverberation room method

Report number:
17-340-R2-M6
Date
2017-12-01

Frequency f [Hz]	Sound absorption coefficient α
50	0.00
63	0.02
80	0.06
100	0.09
125	0.20
160	0.36
200	0.47
250	0.69
315	0.78
400	0.95
500	0.98
630	0.93
800	1.06
1000	0.95
1250	0.87
1600	0.87
2000	0.84
2500	0.84
3150	0.81
4000	0.75
5000	0.68

Client: Fellert Acoustical Ceilings AB
 Manufacturer: Fellert Acoustical Ceilings AB
 Product identification: Fellert Even Better Silk Metallic
 Description of test specimen: 39 mm (1,5 inch) acoustical board (density: 96 kg/m³)
 Type A mounting per ASTM E795
 Weight: 4,2 kg/m²

Reverberation room volume: 200 m³
 Temperature: 16.8 °C (empty: 20.7 °C)
 Air humidity: 36 % (empty: 36 %)
 Air pressure: 98.2 kPa (empty: 100.2 kPa)
 Size of specimen: 10 m²
 Area weight: 4,2 kg/m²
 Measurement date: 2017-11-29
 Measured by: Magnus Karlsson

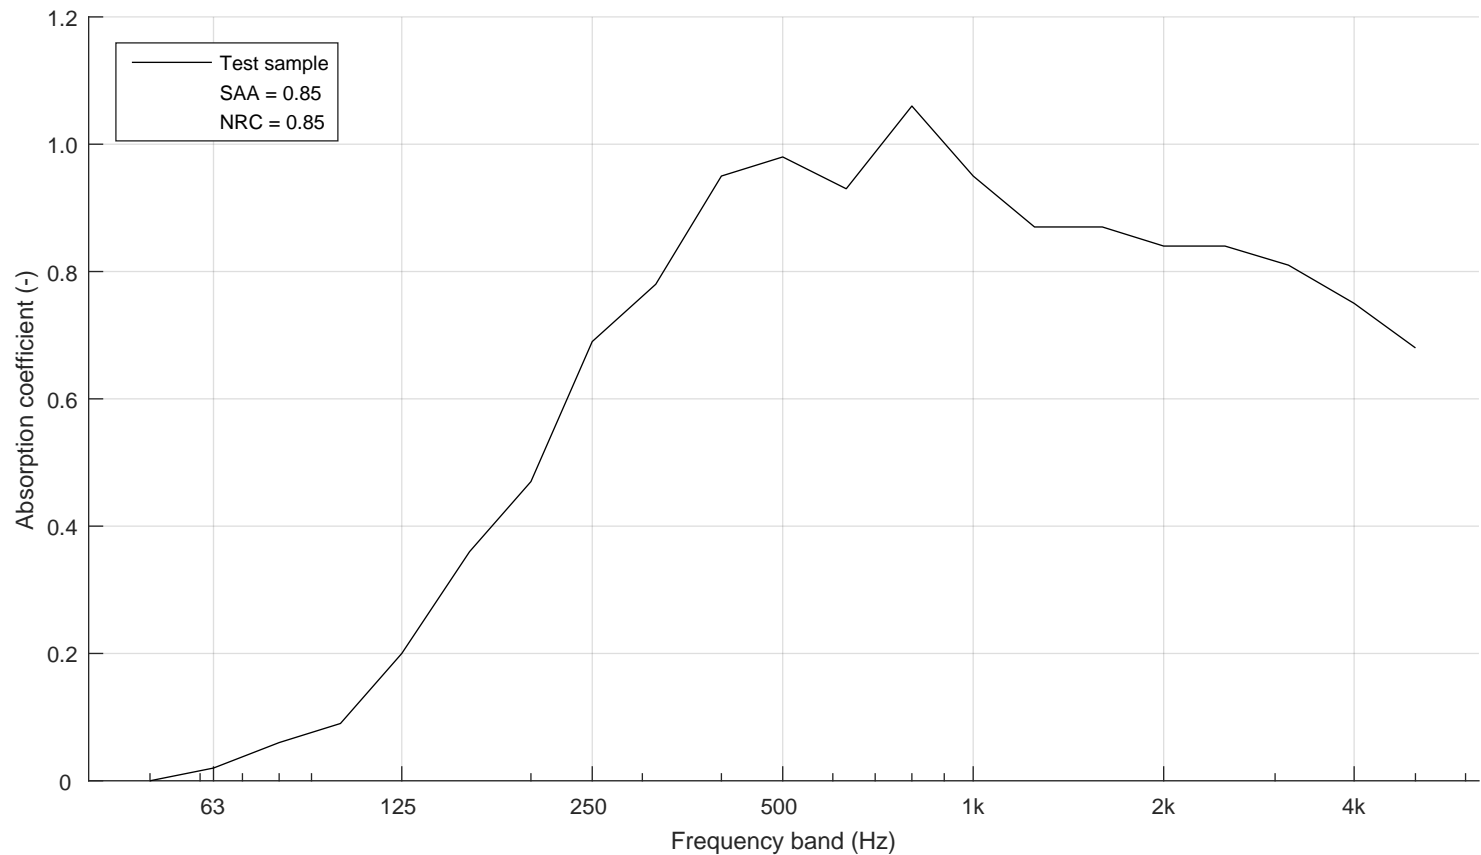

Sound Absorption Average (SAA): 0.85
 Noise Reduction Coefficient (NRC): 0.85